




TEMPORARY ELECTRICAL POLE DIAGRAM

Rev: 4 | Revision Date: 1/8/2025 | Print Date: 1/8/2025 | I.D. Number: EG

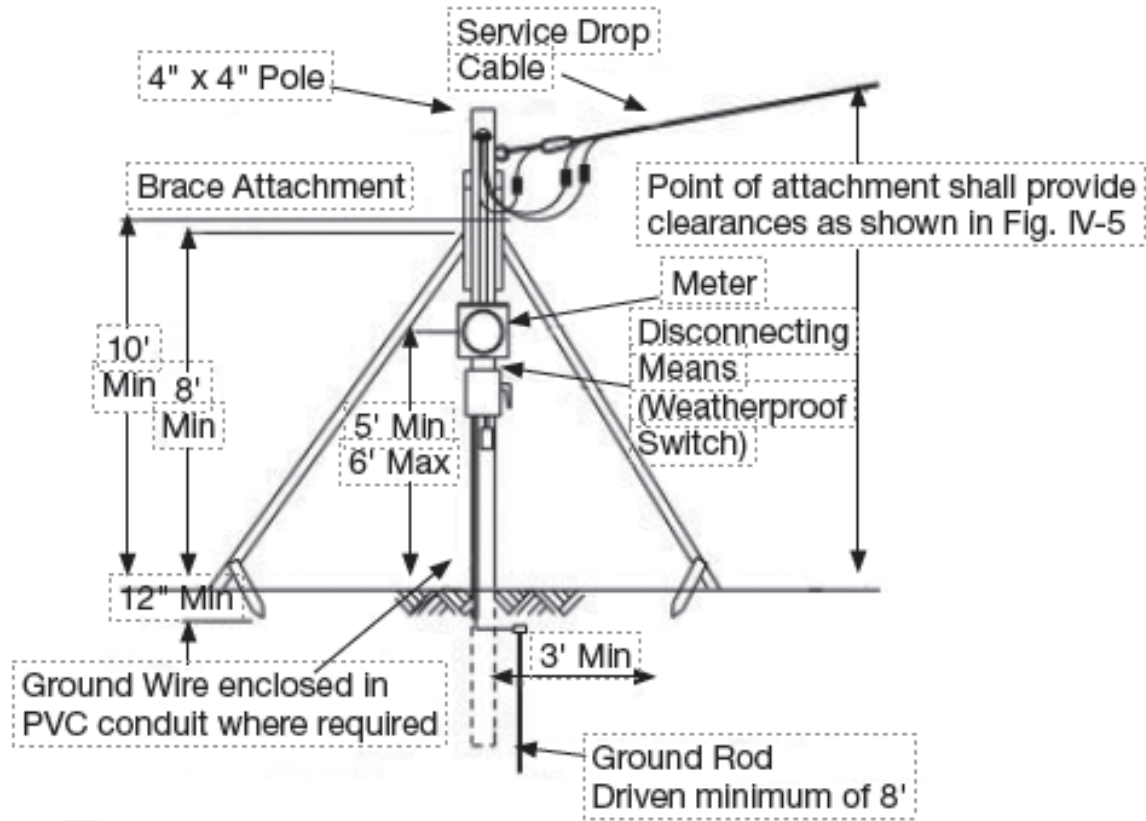

TEMPORARY POLE WILL MEET THE MINIMUM REQUIRED ELEVATION OF _____ NAVD 88.

* PLEASE FILL IN THE BLANK, SAVE, AND INCLUDE WITH YOUR PERMITTING DOCUMENTS.